




F.E.S. END VIEW



SECTION X-X

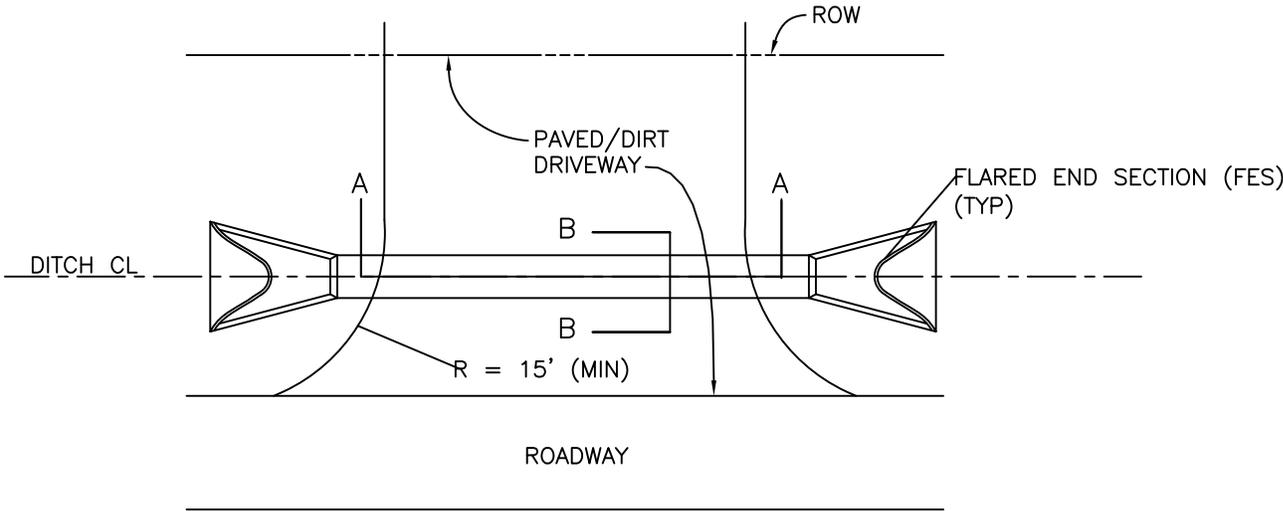

PLAN VIEW

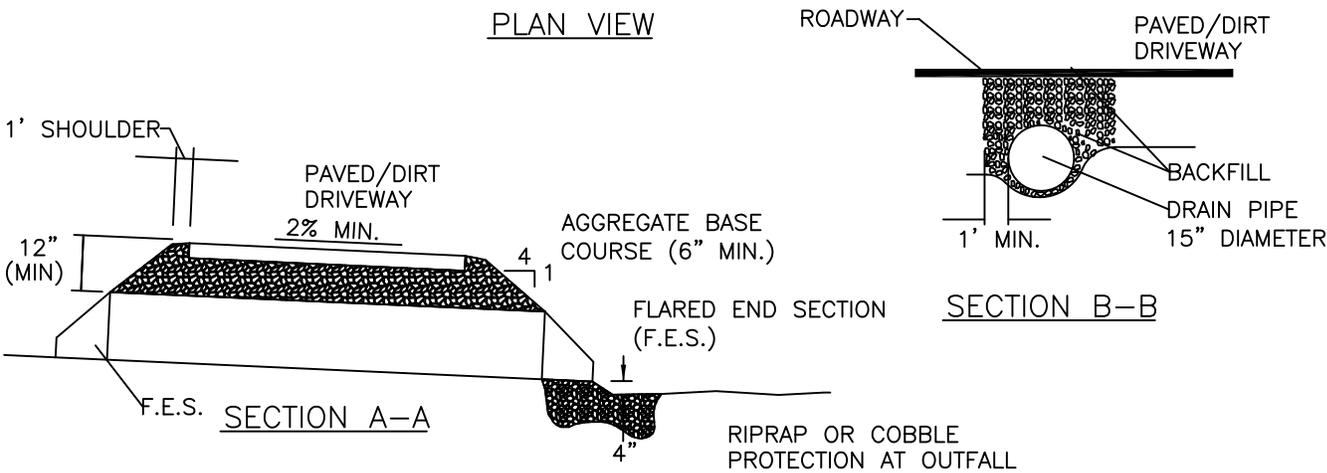

- NOTES:**
1. TOWN ENGINEER MAY REQUIRE DRIVEWAY TO BE ASPHALT OR CONCRETE.
 2. FLARED END SECTIONS ARE REQUIRED AT EACH END OF THE PIPE. ENGINEER SHALL VERIFY THE LOADING ON THE MATERIAL OF PIPE CHOSEN.
 3. MAXIMUM SIDE SLOPE OF DITCH IS 6:1.
 4. THE MINIMUM PIPE SIZE-15" DIAMETER RCP.
 5. THE PROPERTY OWNER SHALL BE RESPONSIBLE FOR MAINTENANCE OF ALL DRAINAGE DITCHES AND CROSSINGS UP TO THE EDGE OF ASPHALT.

ACCESS ON RURAL ROADWAYS- W/O C&G

NTS

