



NOTES:

- 1) PLUG SHALL BE MECHANICALLY RESTRAINED.
- 2) 2" BLOW OFF PIPING MAY BE BRASS WITH THREADED BRASS FITTINGS OR TYPE K SOFT COPPER WITH BRONZE THREADED x COMPRESSION FITTINGS.

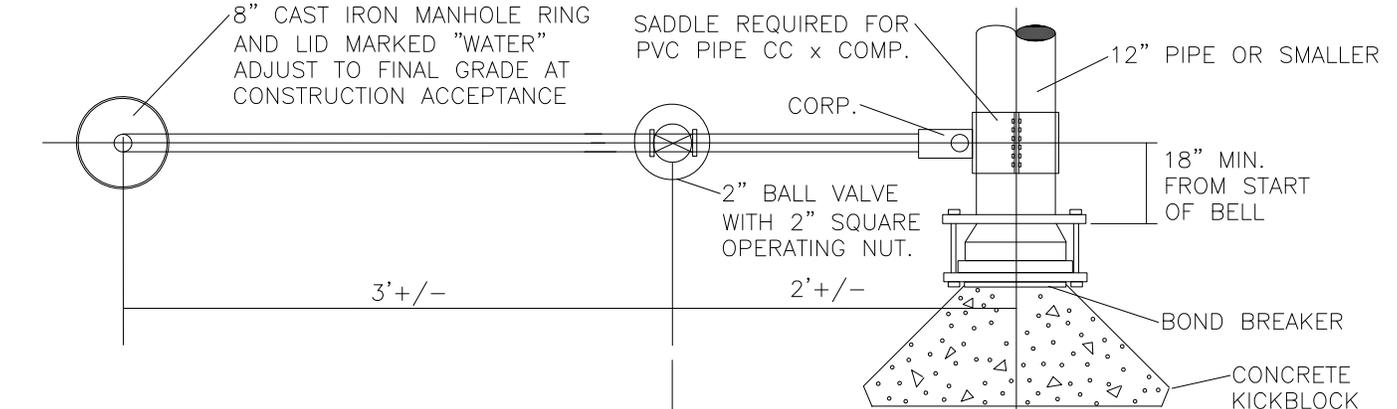

PLAN

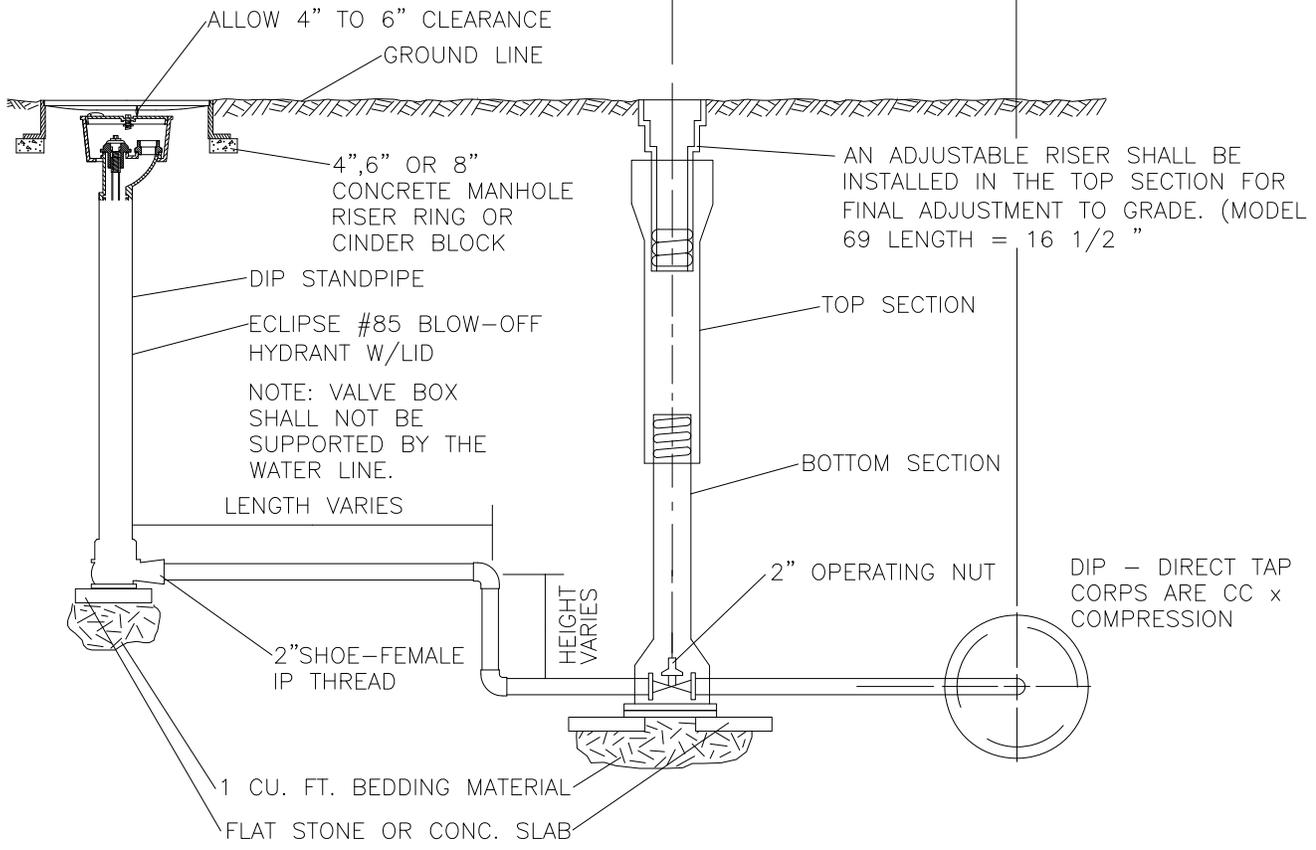

ELEVATION

STD. BLOW-OFF INSTALLATION
FOR 12" & SMALLER PIPE

NTS

