


- NOTES:
- 1) TOWN APPROVED METERS & YOKES ONLY.
 - 2) FITTINGS OUTSIDE THE STRUCTURE MUST BE COMPRESSION TYPE FITTINGS.
 - 3) METER PITS SHALL BE LOCATED 5' OFF SIDE LOT LINES AND OUT OF DRIVEWAYS.
 - 4) CONTRACTOR SHALL MARK THE LOCATION OF THE CURB STOP & BOX WITH A METAL T-POST EXTENDING A MINIMUM OF 4 FT. ABOVE THE GROUND.
 - 5) IF INSTALLATION OF SERVICE LINE IS CONSTRUCTED BY "PUNCHING" UNDER AN EXISTING SIDEWALK/CURB & GUTTER, THEN CONTRACTOR MUST INSTALL A PVC SLEEVE UNDER SIDEWALK/CURB & GUTTER. DIAMETER OF PVC SLEEVE MUST BE WITHIN 1/4" OF "PUNCHED" HOLE.
 - 6) ANY VARIATION OF LOCATION OF METER PITS AND ASSOCIATED APPURTENANCES MUST BE APPROVED BY THE ENGINEER.
 - 7) METER PIT SHALL NOT BE INSTALLED AT THE TIME OF SERVICE LINE INSTALLATION.
 - 8) REFER TO SEC. 700.06 FOR RIGHT OF WAY LOCATION.
 - 9) TOP OF LID TO BE EVEN WITH FINISH GRADE OF LANDSCAPING MATERIALS.

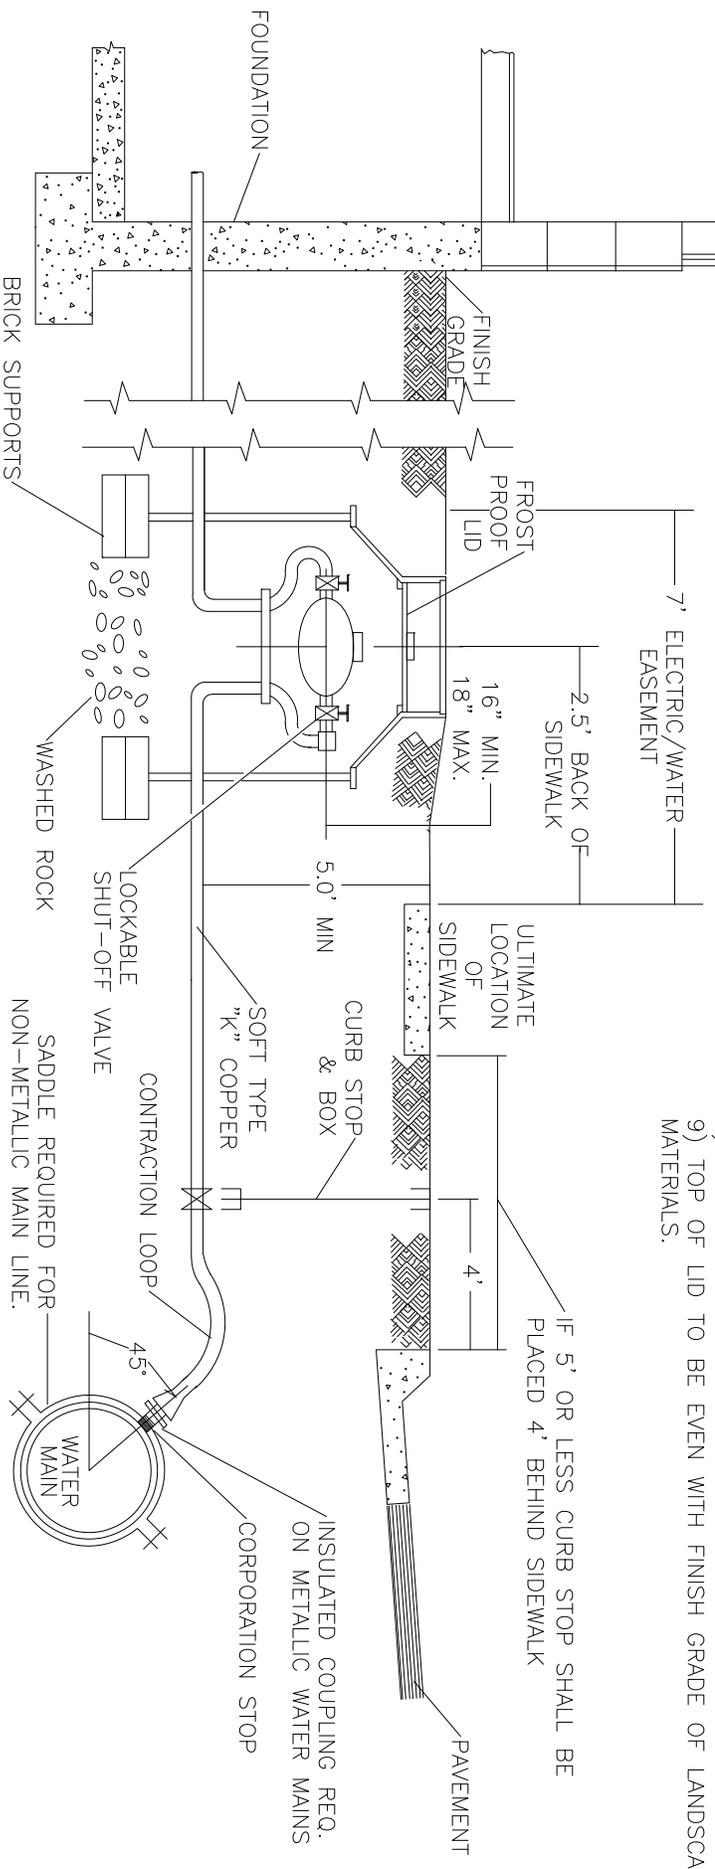

WATER SERVICE AND OUTSIDE METER INSTALLATION DETACHED SIDEWALK

NTS

DATE MODIFIED: FEBRUARY 26, 2019



TOWN OF FREDERICK
STANDARDS & SPECIFICATIONS

700-08