


- NOTES:
- 1: A MINIMUM OF 24 INCHES OF SLACK WIRE SHALL BE INSTALLED FOR EACH WIRE IN THE TEST STATION BOX.
  - 2: ALL WIRES SHALL BE STRANDED COPPER TYPE RHW-2/RHH/USE-2.
  - 3: ALL WIRES SHALL BE ATTACHED TO THE PIPE TOP CENTERLINE.
  - 4: ANODES ARE TO BE PLACED AT PIPE DEPTH OR BELOW AND 5 FEET AWAY FROM THE PIPE.

TEST STATION  
TERMINAL BOARD  
WIRING DETAIL.

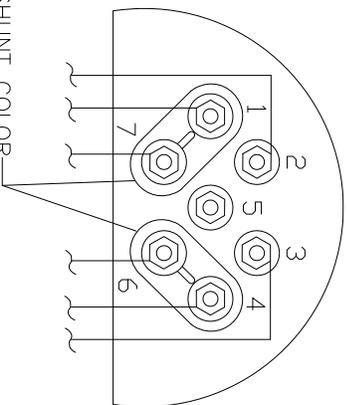

0.01 OHM-8 AMPERE SHUNT COLOR  
CODE - YELLOW COTT MANUF.

TERMINAL AND WIRE #	SIZE	COLOR
1	12 AWG	GREEN
2	12 AWG	GREEN
3	12 AWG	RED
4	12 AWG	RED
5	—	—
6 (A&B)	12 AWG	BLACK/RED
7 (A&B)	12 AWG	BLACK/GREEN

## CATHODIC TEST STATION - TYPE 2

NTS



TOWN OF FREDERICK  
STANDARDS & SPECIFICATIONS

700-14